

ALL DIMENSIONS ARE TO BE CHECKED ON SITE PRIOR TO CONSTRUCTION. THE CONTRACTOR IS TO NOTIFY THE DESIGN TEAM OF ANY DISCREPANCY BETWEEN DRAWINGS, SPECIFICATION AND SITE DIMENSIONS. DO NOT SCALE FROM THIS DRAWING.

- PLAN LEGEND**
- SHADED AREA DENOTES EXISTING STRUCTURE
- NOTE: FABRICATOR TO CHECK ALL DIMENSIONS AND LEVELS ON SITE PRIOR TO FABRICATION
- DRAWING TO BE READ INCONJUNCTION WITH LOCAL HOMES DETAILS

Contractor to confirm whether mastic can be removed from existing window to allow aluminium flashing to fit behind window frame for a neater finish. Thereafter, flexible silicone seal supplied and fitted by the contractor over - TBC

Existing sill width (from ext face of window frame to face of brickwork) to be checked across every window to ensure aluminium sill flashing is adequately sized by supplier prior to any fabrication

Rock / mineral wool insulation fitted on site. Contractor to ensure insulation provides a tight seal to perimeter of window openings under compression, fitting snug to jamb, sill and head flashings.

Timber panel set back 50mm from existing structural opening to allow TOL for any site discrepancies

Timber panel packed on site to suit by contractor

Aluminium profile, supplied by Factory, fitted on site by contractor

Insect mesh supplied and fitted by factory

Fire strip

Laps in membrane to be stapled

50mm full fill cavity, rock / mineral wool nominal density 45 kg/m³, installed on site by Contractor

Glidevale TF200 breathable membrane fitted in Factory

100mm - rock / mineral wool nominal density 45 kg/m³ by Factory

9mm OSB fitted in Factory

Glidevale TF200 breathable membrane fitted in Factory


38 x 50mm treated (min class 2) cladding battens fitted in Factory

Hardie plank horizontal cementitious cladding fitted in factory

Please note: the proposed structural opening of the panels is currently shown 50mm larger, than the existing structural window openings indicated on the site survey to allow for site tolerances

ALUMINIUM FABRICATOR / SUPPLIER TO ENSURE EVERY WINDOW SURROUND IS CLEARLY DENOTED FOR EACH SPECIFIC SITE MEASURED OPENING, IN ACCORDANCE WITH WINDOW REFERENCES AS INDICATED ON INDESIGN ELEVATIONS

Window Cill Detail Cementitious Cladding (Scale 1:5)

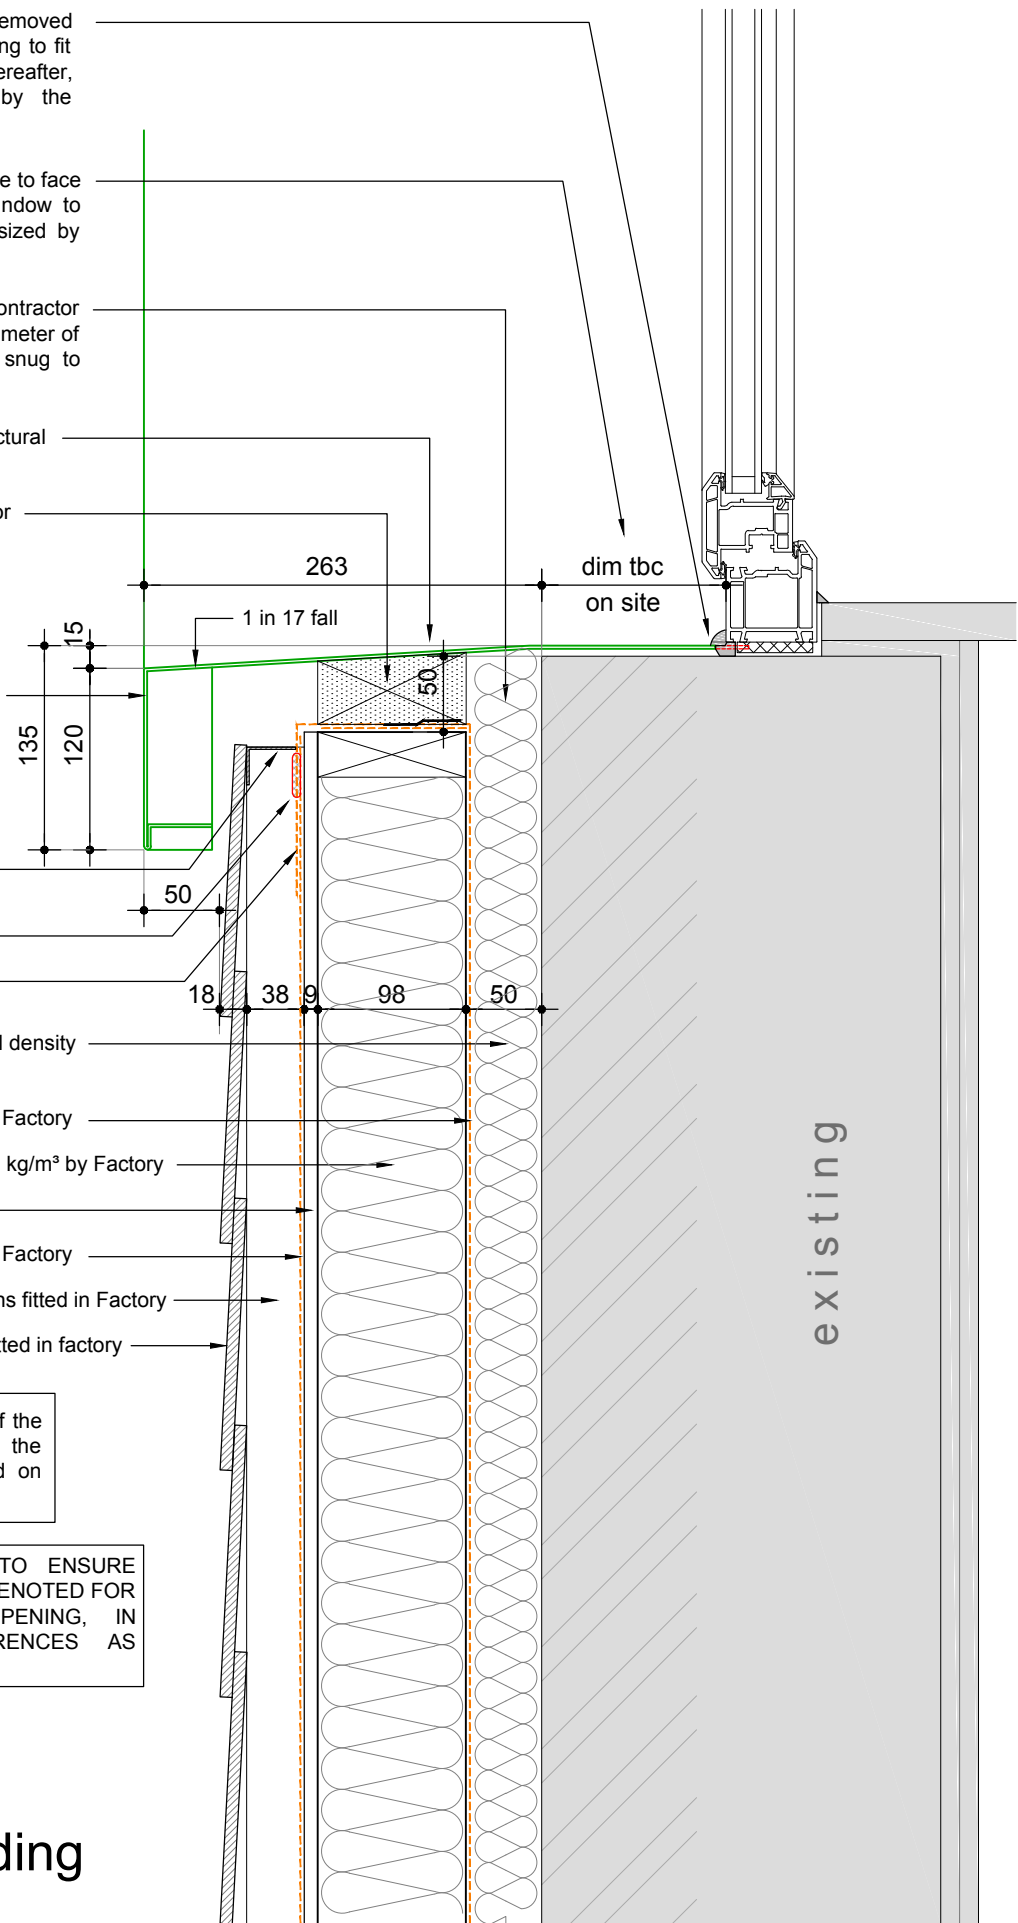

A Aluminium profile revised and insulation added to external face of existing wall. Dwg no. revised 22/08/20 RP

rev	note	date	by



178 Birmingham Road
West Bromwich
West Midlands
B70 6QG
Tel. 0300 111 7000
www.accordha.org.uk

client
Accord Group

project
Black Country Retrofit Wrap and Associated Works
100 - 122 Darlaston Road, Kings Hill, WS10 7SR

title
Window Cill Detail

job	dwg no	rev	date	date
18-1540	511	A	Jul 20	Jul 20